


DRILL TYPE ANCHOR INFORMATION
(DRILL TYPE ANCHORS PROVIDED WITH THE SCALE)
FOR THE CORNER STANDS (12 REQUIRED)
FOR THE FULCRUM & LC STANDS (8 REQUIRED)
5/8 DIA X 6" STUD TYPE ANCHORS
DRILL DIA 5/8", DRILL DEPTH 3 1/2"

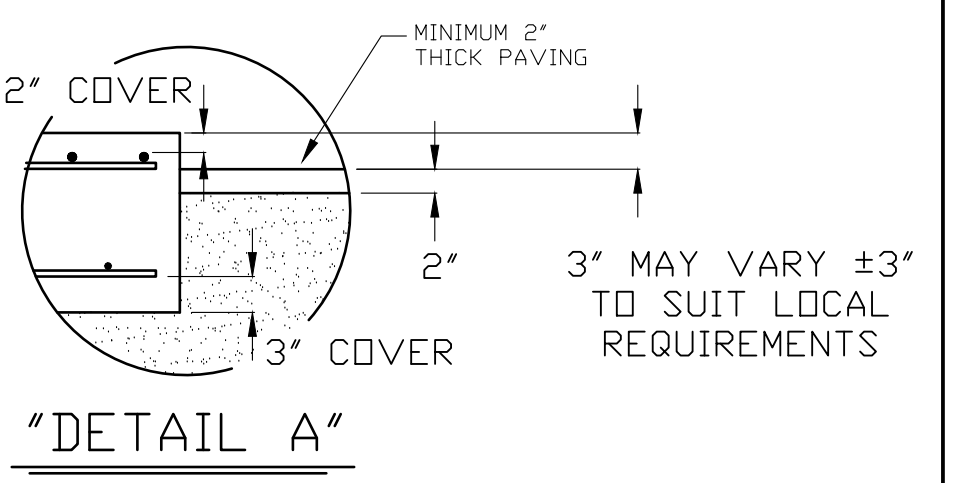


- NOTES:
- FOUNDATION DESIGN IS BASED ON A MINIMUM SOIL BEARING CAPACITY OF 3000 LB/SQ. FT. FOR SOIL CONDITIONS WHICH DO NOT MEET THIS SPECIFICATION, CONSULT WITH THE THURMAN SCALE COMPANY.
 - THE FOUNDATION SHALL BE INSTALLED AT AN ELEVATION AND LOCATION TO INSURE ADEQUATE DRAINAGE AWAY FROM SCALE. A PERIMETER TRENCH AND AGGREGATE BASE MAY BE ADDED IF DRAINAGE IS NOT SUFFICIENT TO MAINTAIN 3000 LB/SQ. FT. BEARING CAPACITY.
 - BOTTOM OF FOOTERS SHOULD EXTEND BELOW THE FROST LINE. AN 18 INCH FOOTER DEPTH IS MINIMUM.
 - N.I.S.T. H-44 REQUIREMENTS AND LOCAL WEIGHTS AND MEASURES REGULATIONS MAY REQUIRE INSTALLATION PARAMETERS SOMEWHAT DIFFERENT THAN ILLUSTRATED ON THIS PLAN. IN ORDER TO INSURE COMPLIANCE, CONSULT THE LOCAL WEIGHTS & MEASURES OFFICE PRIOR TO CONSTRUCTION.
 - CONCRETE OF 4000 PSI MINIMUM COMPRESSIVE STRENGTH IS REQUIRED, WITH 5-7% AIR ENTRAINMENT. VIBRATE CONCRETE WHEN POURING. FOLLOW LATEST ACI REQUIREMENTS FOR MATERIALS AND CONSTRUCTION. DO NOT CAST UNLESS TEMPERATURE IS ABOVE 40 DEGREES FAHRENHEIT.
 - PIERS MUST BE LEVEL AND IN THE SAME PLANE WITHIN ±1/8 INCH.
 - EXCAVATION, FORMS, REINFORCING STEEL, GUARD POSTS, AND CONCRETE FURNISHED BY OTHERS.
 - DO NOT PLACE REBAR IN CLOSE PROXIMITY OF ANCHOR BOLTS.

TYPICAL SIDE ELEVATION OF SCALE INSTALLATION

FOUNDATION REBAR SCHEDULE						
ASTM A615 GRADE 60						
MARK	QTY.	SIZE	LENGTH	WT.	REMARKS	
HR1	34	#4	9'-6"	216	(17) EA. APPROACH LONG.	
HR2	79	#4	16'-0"	845	(14) EA. APPROACH LAT; (17) EA. PIER LAT.	
HR3	102	#4	3'-0"	205	(34) EA. PIER LONG.	
HR4	2	#4	10'-0"	14	(2) DUAL FULCRUM PIER LONG.	
HR5	9	#4	1'-4"	8	(3) EA. FULCRUM PIER LAT.	
HR6	4	#4	2'-0"	6	(2) EA. FULCRUM PIER & LC PIER LONG.	
HR7	3	#4	1'-0"	3	(3) LC PIER LAT.	
VR1	68	#4	2'-9"	125	(34) EA. END WALL VERTICAL	
				TOTAL WT.	1422	

CONCRETE REQUIREMENTS	
4000 PSI	
AREA	QTY. (CU. YDS.)
PIERS AS SHOWN	10
APPROACHES	10
FLOOR AT 2" THICK	5.5
OPTIONAL APPROACH SUPPORTS	3.5
TOTAL	29.0

- REINFORCING STEEL NOTES:
- REINFORCING STEEL SHALL BE FREE OF ALL MUD, DEBRIS, CEMENT GROUT, LOOSE RUST, GREASE, AND OIL.
 - TACK WELDING OF BARS IS PROHIBITED.

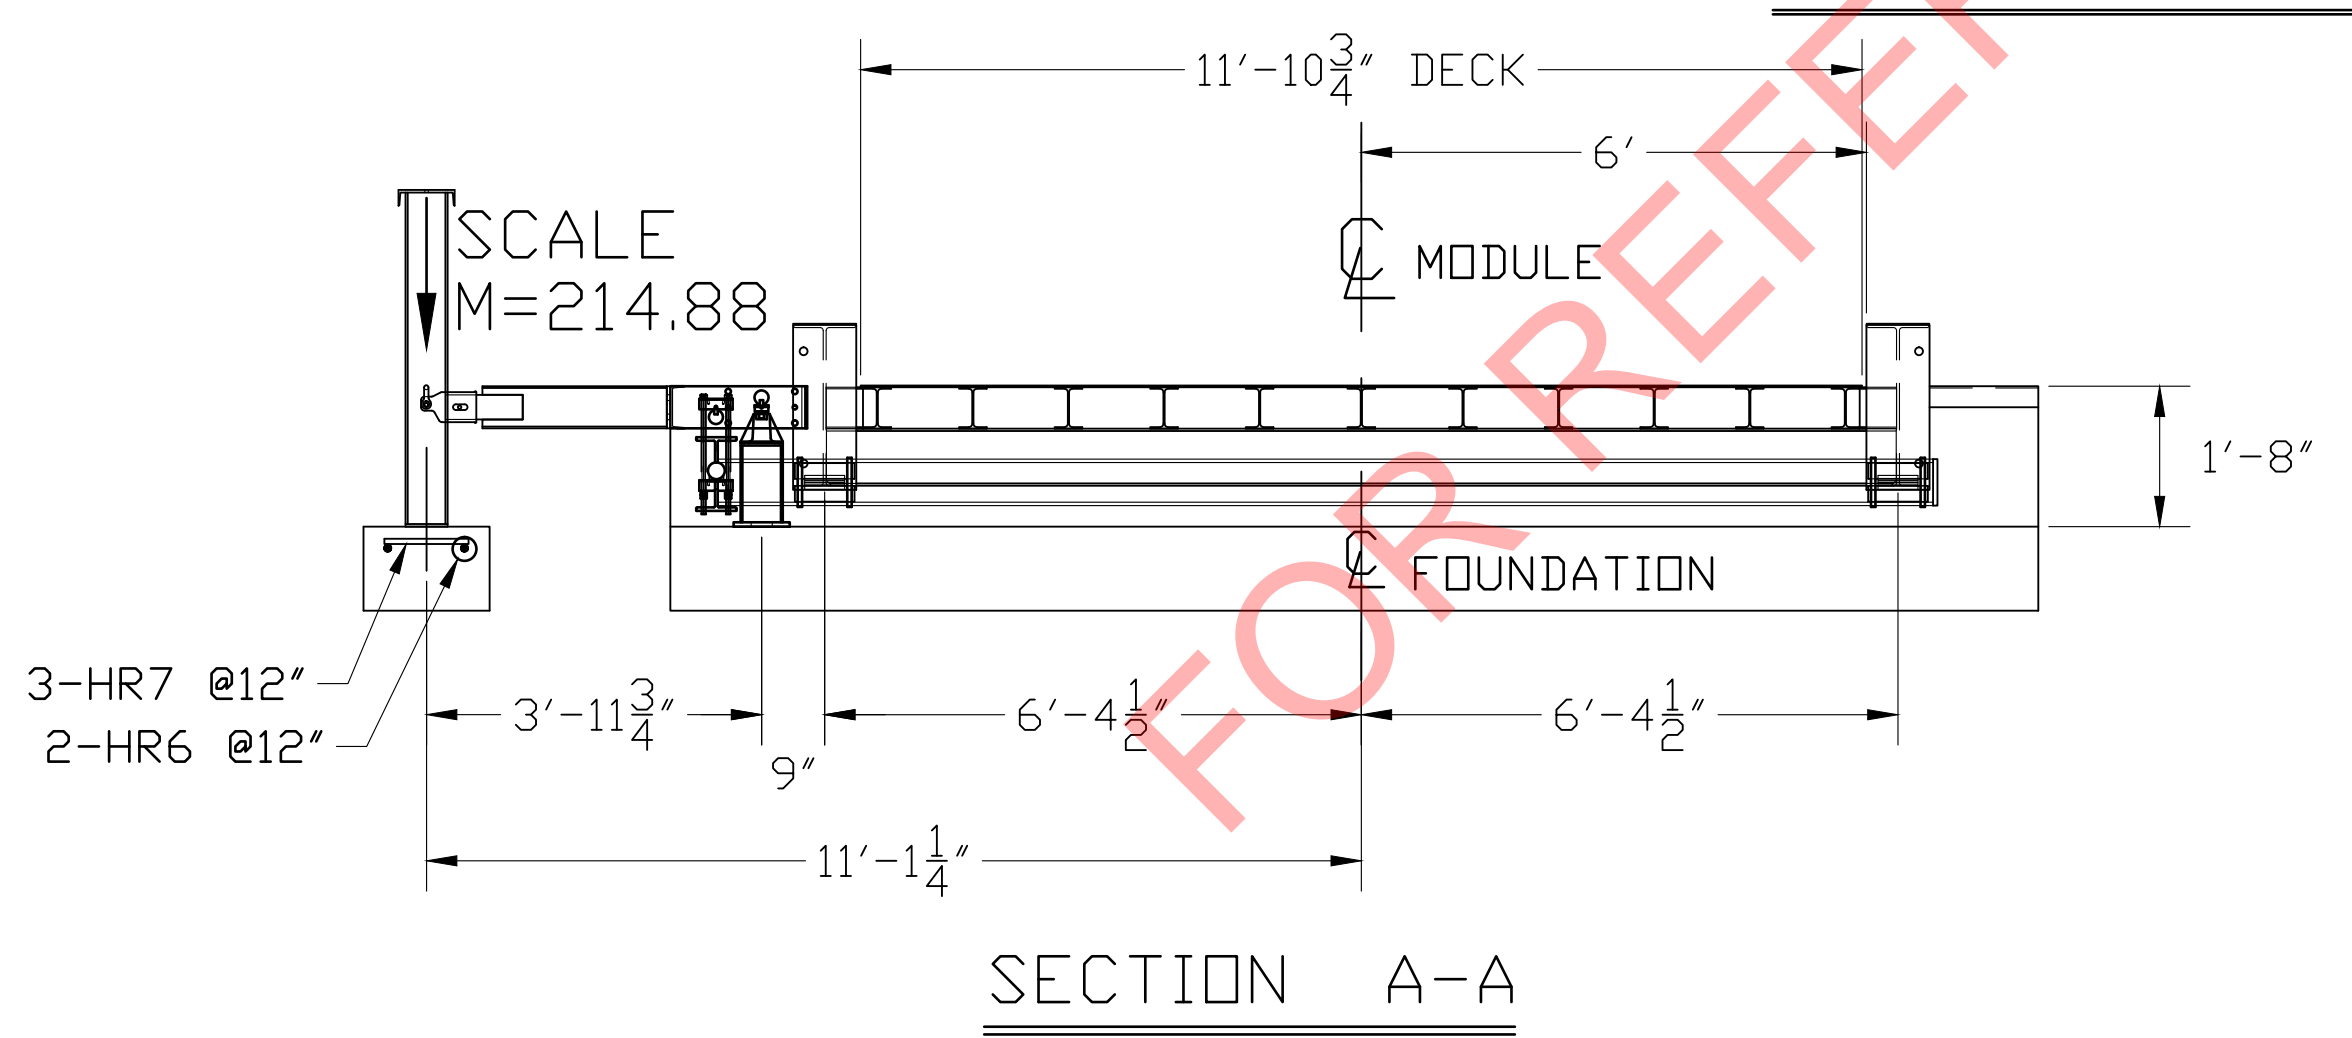

THIS DRAWING IS SUPPLIED AS CHECKED BELOW:
 REFERENCE (ESTIMATES ONLY, NOT FOR CONSTRUCTION)
 CERTIFIED FOR CONSTRUCTION, THURMAN #
 CUSTOMER:
 CUSTOMER P.O.# DATE:
 CUSTOMER APPROVAL, RETURN ONE COPY.
 (ORDER ON HOLD UNTIL SIGNED COPY IS RETURNED)
 APPROVED AS DRAWN, APPROVED BY: DATE:
 APPROVED AS NOTED, APPROVED BY: DATE:

LET	BY	DATE	REVISION

THURMAN SCALE
COLUMBUS, OH

8140 90K CLC
60' X 12' FOOTINGS
FOUNDATION (3 SECTION)

DATE: 11/2/12
SCALE: N/A SHEET 1 OF 1
DRAWN BY: JCR MODEL:
CHECKED BY: LC DRAWING NUMBER: 92695-FT REVISION: 0
APPROVED BY: LC

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES FRACTIONS ±1/8" ANGLES ±1° 3-PLACE DECIMAL ±0.005 2-PLACE DECIMAL ±0.05 1-PLACE DECIMAL ±0.50 HOLE DIMETERS ±1/32"

MATERIAL: A36 FINISH: N/A