


N.I.S.T. H-44 requires that on the approach ends of this vehicle scale, there shall be a straight approach at least half the length of the platform but not required to be more than 40 feet. Not less than 10 feet of any approach adjacent to the platform shall be level and constructed of concrete or similar durable material. Any slope in the remaining portion of the approach shall insure ease of vehicle access, ease for testing purposes, and drainage away from the scale.



NOTE: PROVIDE MEANS FOR ADEQUATE DRAINAGE OF THE PIT. CONNECT DRAIN TO GRAVITY DRAIN, STORM SEWER OR SUMP PUMP TO INSURE THAT STANDING WATER CANNOT ACCUMULATE IN PIT.

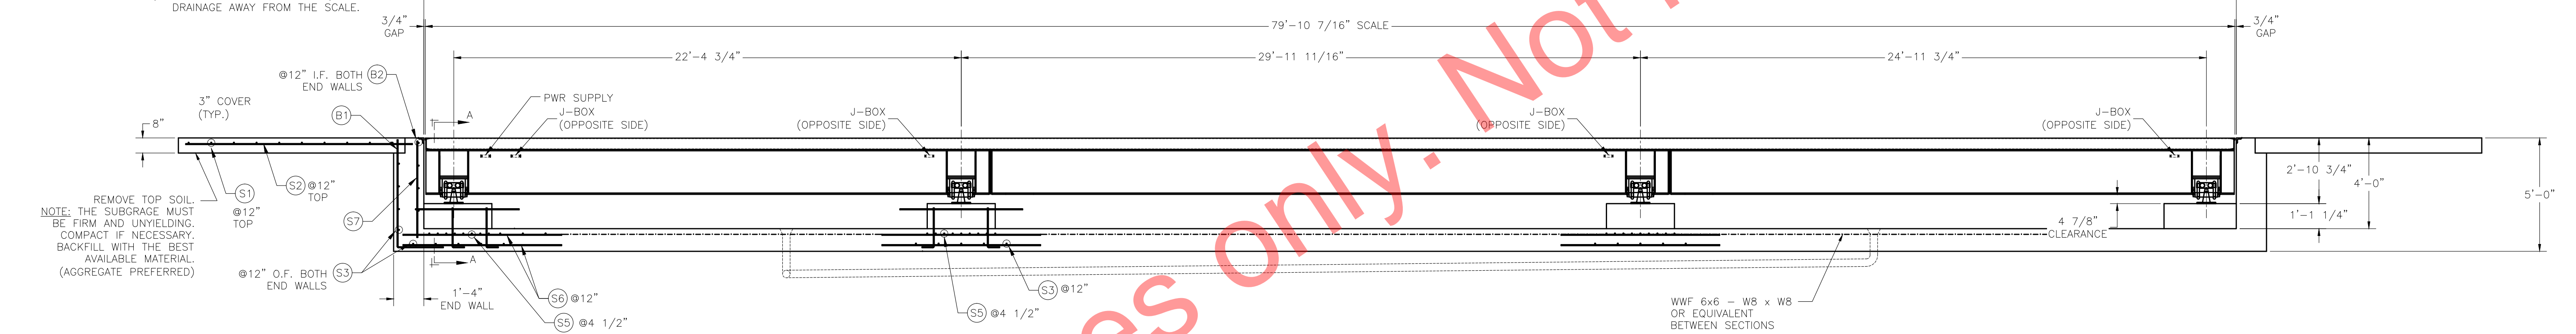


REMOVE TOP SOIL. NOTE: THE SUBGRADE MUST BE FIRM AND UNYIELDING. COMPACT IF NECESSARY. BACKFILL WITH THE BEST AVAILABLE MATERIAL. (AGGREGATE PREFERRED)

- NOTES:
- FOUNDATION DESIGN IS BASED ON A MINIMUM SOIL BEARING CAPACITY OF 1500 LB/SQ. FT. FOR SOIL CONDITIONS WHICH DO NOT MEET THIS SPECIFICATION CONSULT WITH THE THURMAN SCALE COMPANY.
  - PIT FLOOR MUST HAVE AN EFFECTIVE DRAIN SYSTEM SO THAT THE PIT FLOOR REMAINS REASONABLY DRY AND CLEAN.
  - THE TOPS OF THE PIT WALLS MUST BE ABOVE THE EXISTING GRADE LEVEL SO THAT WATER WILL DRAIN AWAY FROM THE SCALE.
  - IN AREAS OF THE COUNTRY WHERE THERE IS SEVERE FREEZING, INCREASE THE DEPTH OF THE FOUNDATION SO THAT THE BOTTOM EXTENDS BELOW THE FROST LINE, OR PROVIDE A MINIMUM OF 12" FREE DRAINING GRANULAR MATERIAL TO PREVENT FROST HEAVE.
  - REINFORCING STEEL IS TO CONFORM TO ASTM A615 GRADE 60 SPECIFICATIONS.
  - CONCRETE OF 4000 PSI MIN. COMPRESSIVE STRENGTH WITH AIR ENTRAINMENT 5-7% IS REQUIRED FOR PIT. CONSOLIDATE CONCRETE INTO POSITION BY VIBRATING.
  - PIERS MUST BE LEVEL AND IN THE SAME PLANE WITHIN  $\pm 1/8$  INCH.
  - EXCAVATION, FORMS, REINFORCING STEEL, AND CONCRETE FURNISHED BY OTHERS.
  - FOUNDATION REQUIREMENTS VARY FROM STATE TO STATE. CHECK WITH LOCAL WEIGHTS AND MEASURES DIVISION BEFORE CONSTRUCTION.

- DECK NOTES:
- REINFORCING STEEL IS TO CONFORM TO ASTM A-615 GRADE 60.
  - CONCRETE OF 4000 PSI MINIMUM COMPRESSIVE STRENGTH IS REQUIRED, WITH AIR ENTRAINMENT OF 5-7 PERCENT IF SUBJECTED TO FREEZE/THAW CYCLES. CONSOLIDATE THE CONCRETE INTO PLACE BY USING A VIBRATOR.
  - CORRUGATED SHEET REQUIREMENTS: A 10' WIDE SCALE REQUIRES (5) SHEETS MIN. TO COVER THE DECK WIDTH. SHEET LENGTHS MAY VARY, BUT ENDS MUST REST OVER (OR LAP OVER) A CROSS BEAM. TACK WELD IN PLACE AS NEEDED. RECOMMENDED SHEET SIZE: 28 GA. X 30 INCH WIDE (MIN.), 3/4 INCH MAX. CORRUGATE HEIGHT (MAXIMUM PROFILE) SUPPORT SHEETING DURING POURING AND CURING AS REQUIRED.
  - MANHOLE REQUIREMENTS: MANHOLE RING & COVER (NEENAH #R06044A OR EQUIVALENT) IS REQUIRED TO GAIN ACCESS TO THE PIT, UNLESS OTHER MEANS OF ENTRY ARE PROVIDED. BEND BARS AROUND MANHOLE, DO NOT CUT.
  - REBAR, CONCRETE, CORRUGATED SHEETS AND MANHOLES ARE SUPPLIED BY OTHERS UNLESS SPECIFIED ON THE SALES ORDER.

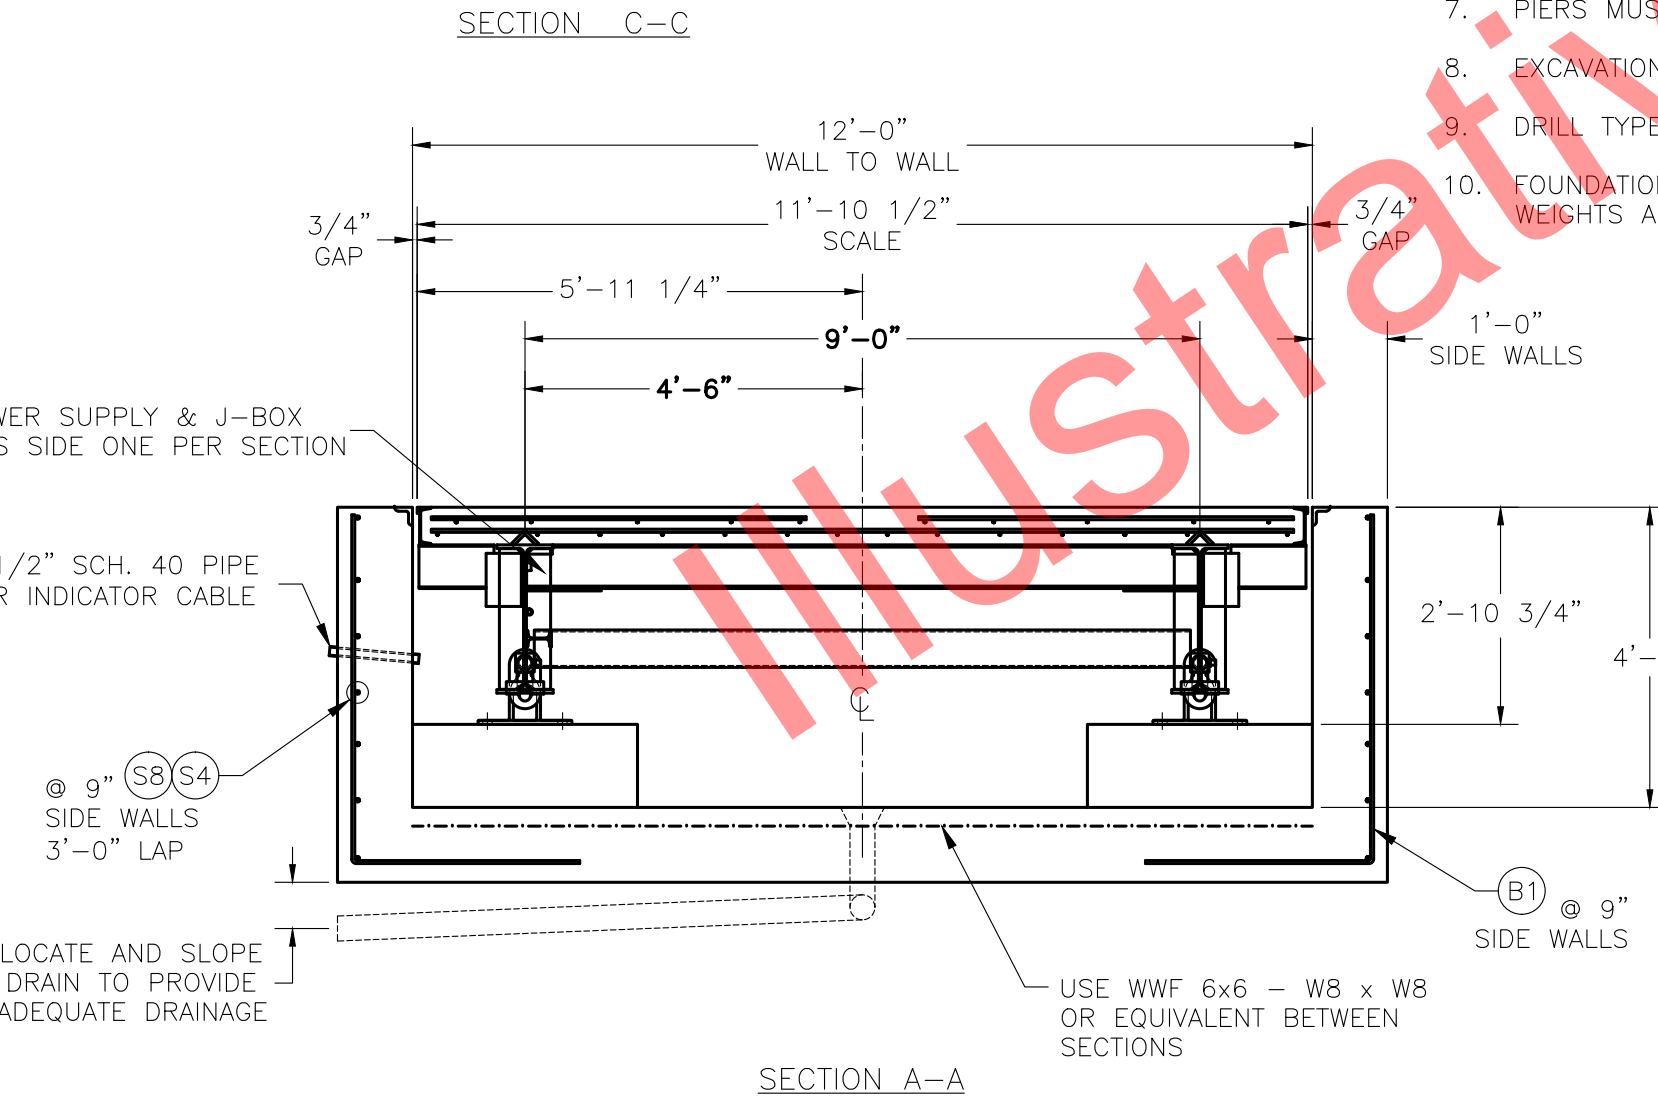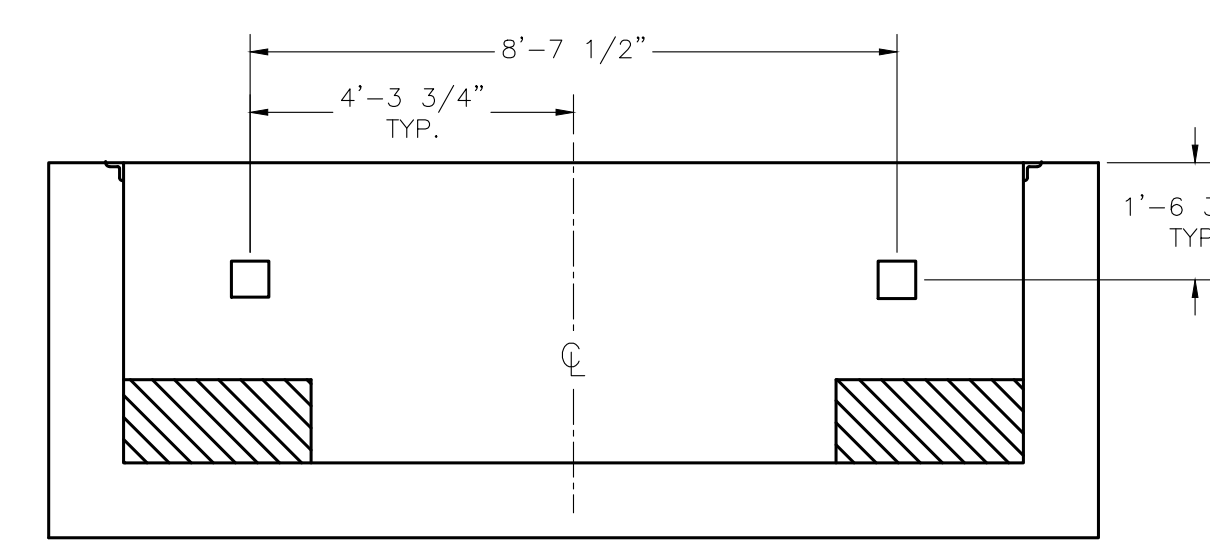



REBAR PLACEMENT SCHEDULE							
BARS B1, B3		BARS B2		BARS B4		BARS B5	
BAR SYM	BAR SIZE	QTY.	BAR LENGTH	A	B	C	WEIGHT (LBS)
S1	#4	20	11'-6"				154
S2	#4	24	9'-6"				253
S3	#4	28	13'-6"				749
S4	#4	56	20'-0"				325
S5	#6	36	13'-6"				487
S6	#4	104	7'-0"				75
S7	#4	28	4'-0"				131
S8	#4	14	14'-0"				1,193
B1	#4	238	7'-6"	4'-6"	3'-0"		1,077
B2	#4	8	20'-0"	12'-8"	3'-8"		38
B3	#4	28	2'-0"	1'-6"	0'-6"		39
B4	#4	4	14'-6"	2'-6"	4'-0"	2'-0"	30
B5	#4	4	11'-0"	3'-0"	4'-0"	2'-0"	30
TOTAL DECK REBAR							3,734
PLUS APPROX. 720 SQFT. OF WWF 6x6 - W8xW8							

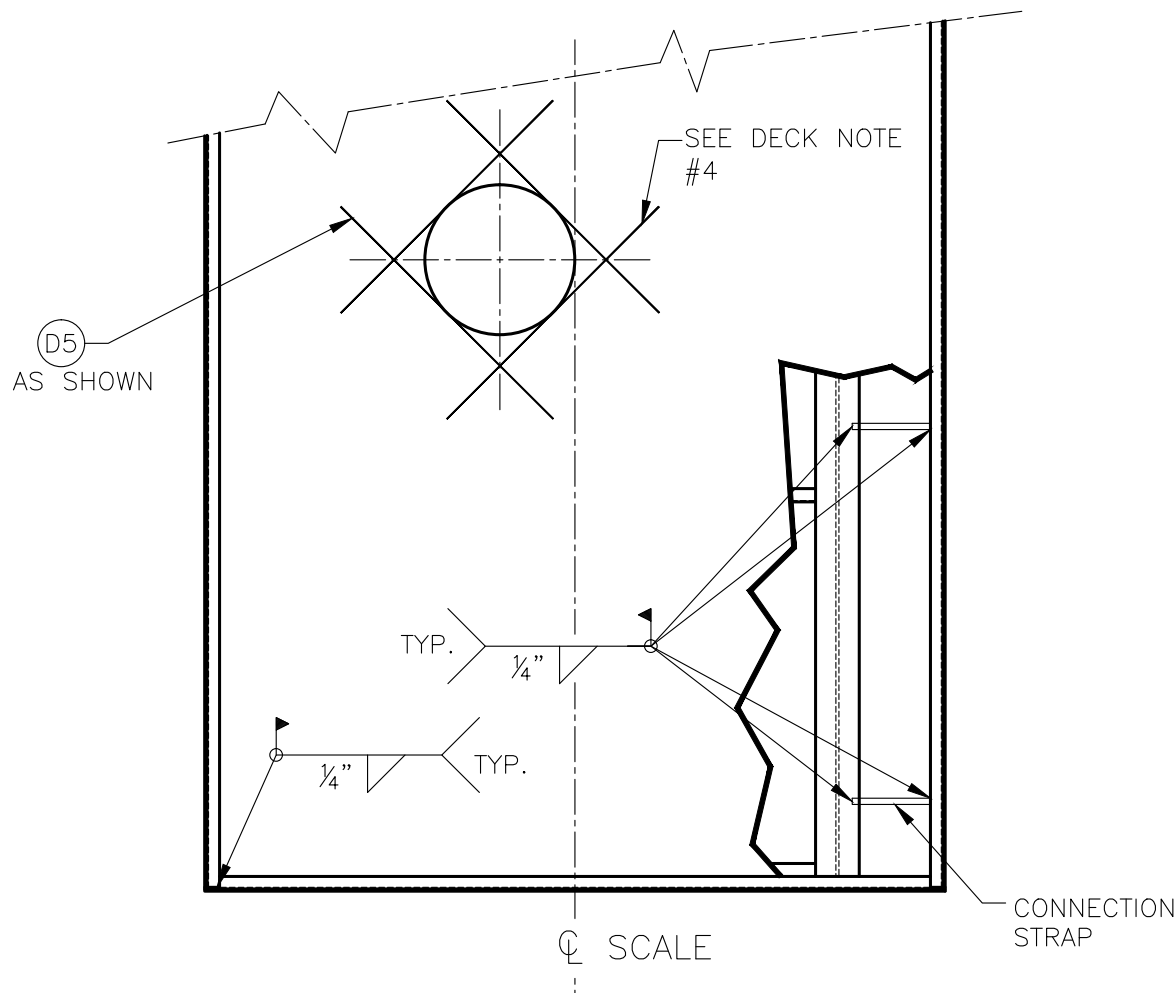

CONCRETE REQUIREMENTS			
LOCATION	QTY.		
FLOOR (*)	43.0		
APPROACHES/WALLS	28.0		
PIERS	4.0		
DECK	18.0		
TOTAL	93.0		

(\*) CONCRETE QUANTITY FOR FLOOR IS CALCULATED FOR A 12" FLOOR DEPTH

DECK REBAR PLACEMENT SCHEDULE				
BAR SYM	BAR SIZE	QTY.	BAR LENGTH (LBS)	REMARKS
D1	#4	482	5'-0"	LATERAL TOP
D2	#4	321	11'-6"	LATERAL BTM
D3	#4	40	20'-0"	LONG. TOP; (SPLICE 4 BARS)
D4	#4	56	20'-0"	LONG. BTM; (SPLICE 4 BARS)
D5	#4	8	4'-0"	22 4 PER MH
D6	#4	24	12'-0"	193 LONG. SPLICE
TOTAL REBAR =			5,575	LBS

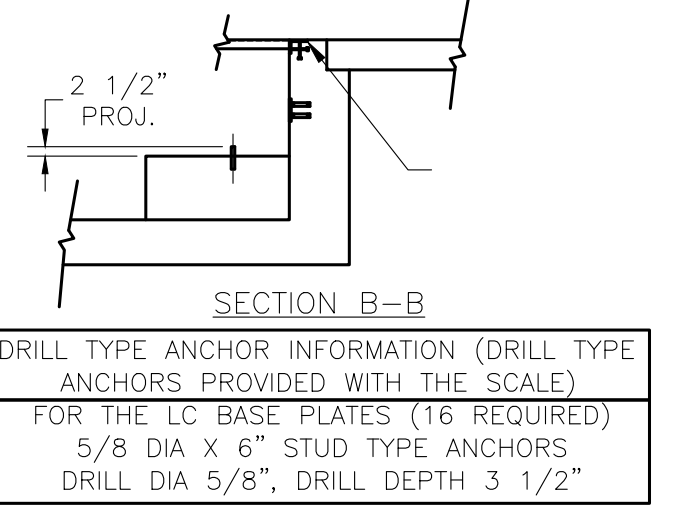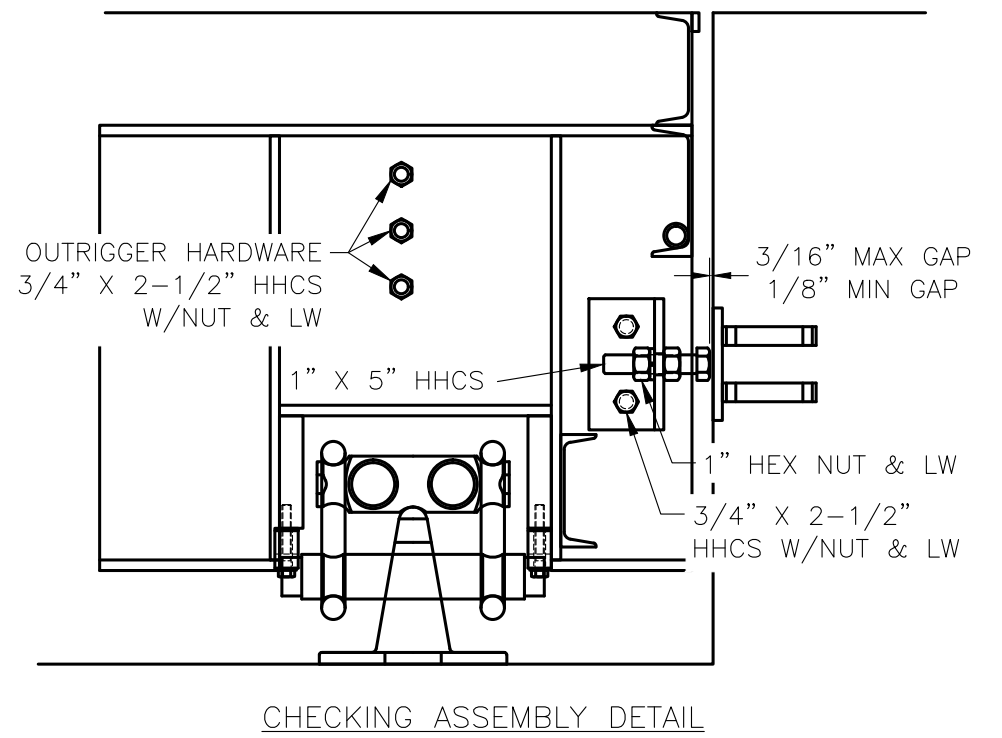

THIS DRAWING IS SUPPLIED AS CHECKED BELOW:
[X] REFERENCED (ESTIMATES ONLY, NOT FOR CONSTRUCTION)
[ ] CERTIFIED FOR CONSTRUCTION, THURMAN SERIAL#
CUSTOMER:
DATE:
[ ] CUSTOMER APPROVAL, RETURN ONE COPY.
(ORDER ON HOLD UNTIL SIGNED COPY IS RETURNED)
APPROVED AS DRAWN, APPROVED BY:
DATE:
APPROVED AS NOTED, APPROVED BY:
DATE:

8510DB 90K CLC 80" x 12"
4 SECTION DESB
FOUNDATION DRAWING - 4' DEEP PIT
THURMAN SCALE
SCALE: VARIOUS DRAWN: LDC
SHEET: 1 OF 1 DATE: 5/7/13
DRAWING NUMBER: 92711-DP4